



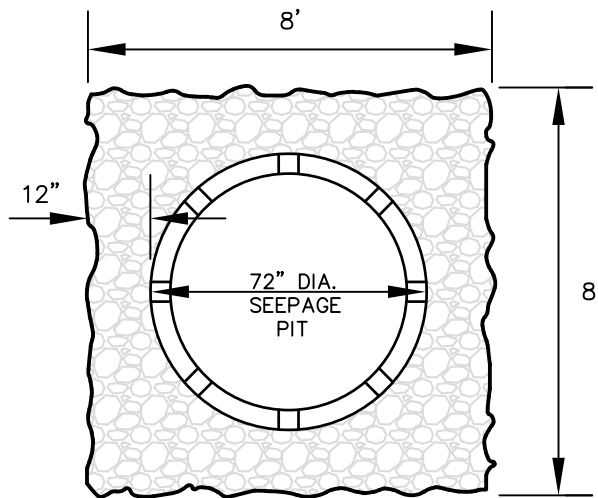


PLAN

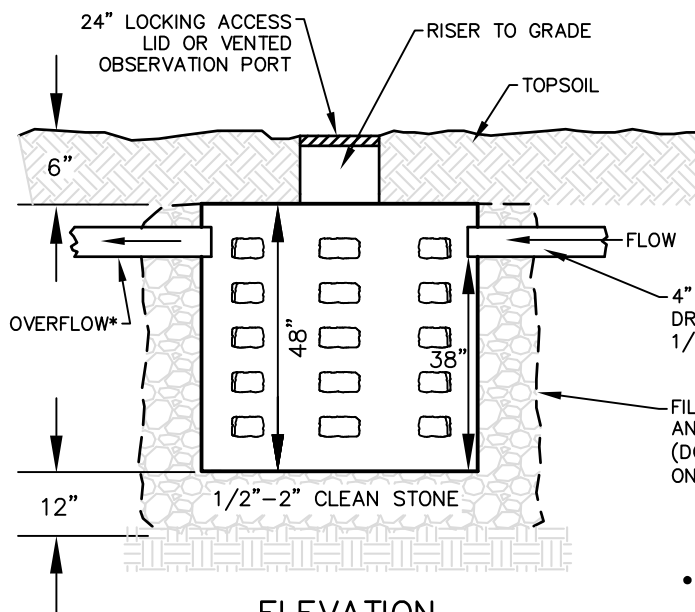

ELEVATION

THIS DETAIL AND CALCULATION IS RECOMMENDED BASED ON 4" OF RUNOFF OVER THE IMPERVIOUS AREA. OWNERS ENGINEER TO VERIFY FINAL DESIGN.

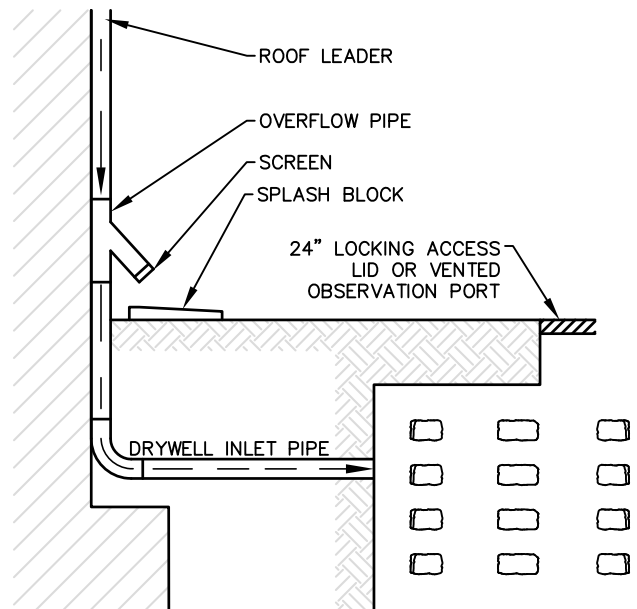

OVERFLOW DETAIL

*ROOF LEADER OVERFLOW TO BE PROVIDED IF NO DIRECT OVERFLOW PIPE INSTALLED TO DRYWELL

- DRYWELLS TO BE LOCATED A MINIMUM OF 10' FROM ANY PROPERTY LINE
- DRYWELLS TO BE LOCATED A MINIMUM OF 15' FROM ANY STRUCTURE THAT INCLUDES A BASEMENT
- DRYWELLS TO BE LOCATED A MINIMUM OF 50' FROM SEWAGE DISPOSAL FIELD, INCLUDING ADJACENT PROPERTIES
- OWNERS TO CONTACT TOWNSHIP ENGINEER IF THE PROPOSED DRYWELL CANNOT MEET MINIMUM REQUIREMENTS
- OWNER MAY CONSIDER PLASTIC INFILTRATOR SYSTEMS IN LIEU OF CONCRETE TANKS AS LONG AS NET STORAGE IS SIMILAR



PEQUANNOCK TOWNSHIP

530 NEWARK-POMPTON TPK
POMPTON PLAINS, NJ 07444
PHONE (973) 835-5700
FAX (973) 835-9396

DRY WELL DETAIL 400 - 599 S.F.

STANDARD DETAIL
ENGINEERING DEPARTMENT

PEQUANNOCK TOWNSHIP

MORRIS COUNTY

NEW JERSEY

SCALE: N.T.S. DATE: FEB 2022 SHEET 1 OF 1